
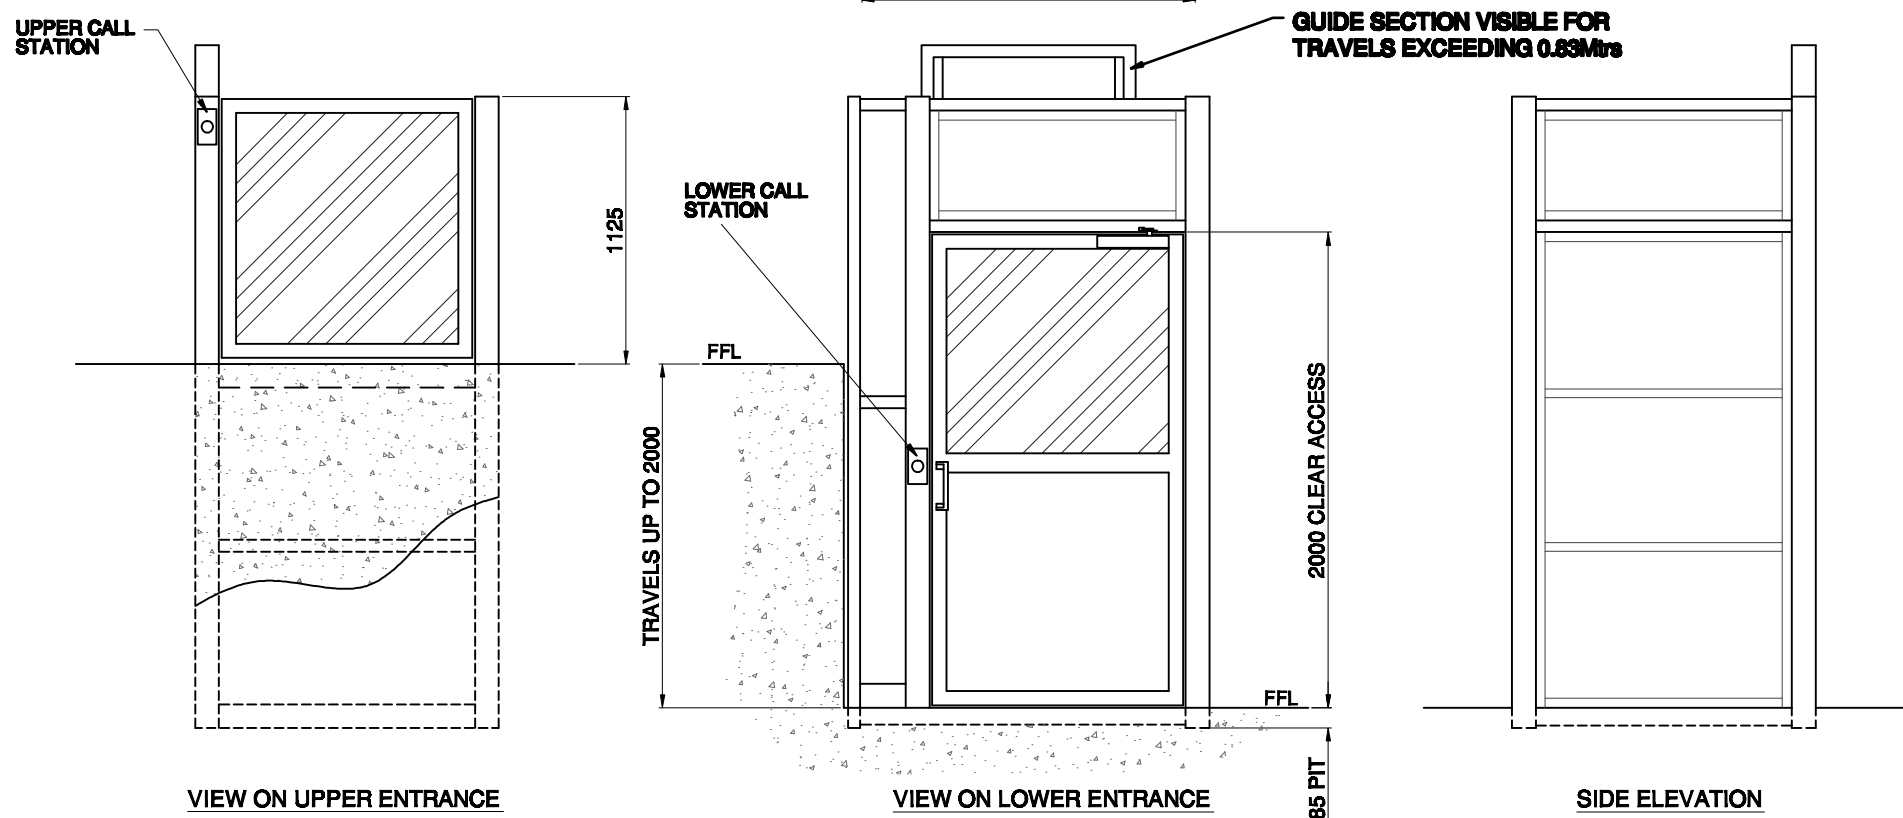


NOTES

- 1 -- TO PROVIDE A SMOOTH TRANSITION BETWEEN FLOOR AND PLATFORM LEVELS, AN 85mm DEEP PIT SHALL BE REQUIRED. IF A PIT IS NOT AVAILABLE AN 85mm HIGH RAMP SHALL BE PROVIDED.
- 2 -- THE MAXIMUM HEADROOM REQUIRED IS A FUNCTION OF THE BASIC FLOOR TO FLOOR DIMENSION.
- 3 -- THE APERTURE THROUGH THE FLOOR (IF APPLICABLE) SHALL BE IDENTICAL SIZE TO PIT DIMENSIONS AND SHALL BE DIRECTLY ALIGNED.
- 4 -- THE DATA SHEET IS INTENDED FOR INFORMATION PURPOSES ONLY. WE RESERVE THE RIGHT TO AMEND ANY DESIGN ASPECTS WITHOUT PRIOR NOTICE.

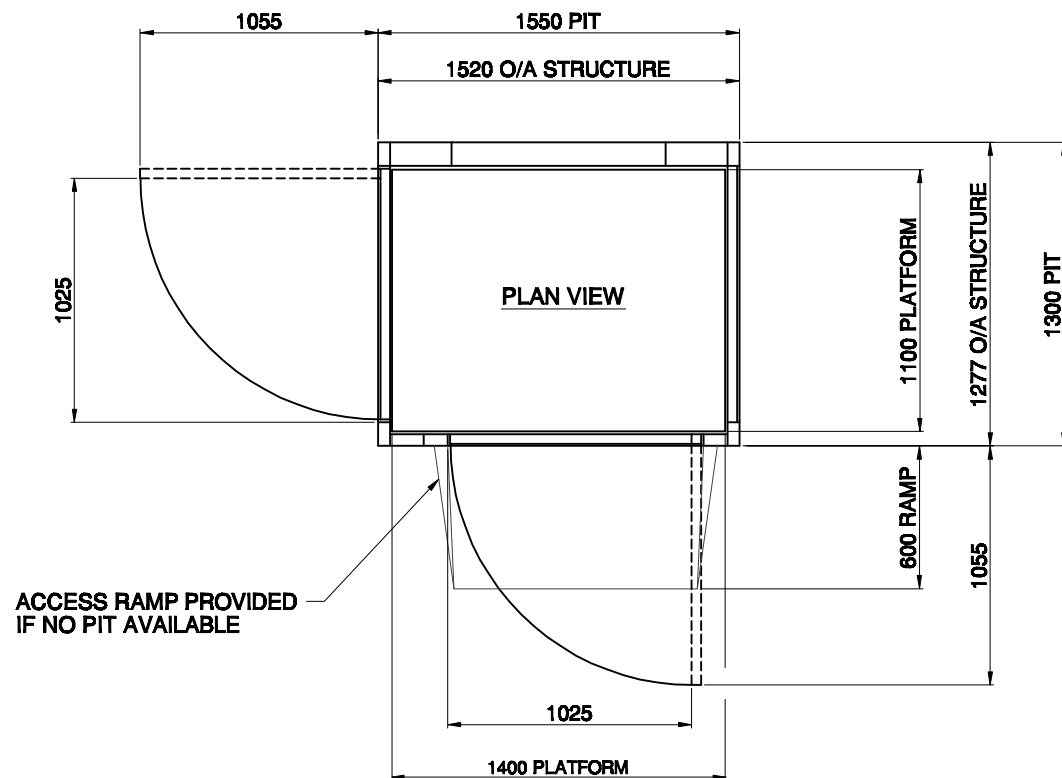

CONTROL CABINET (NOT SHOWN)
810w X 610h X 325d
LOCATED WITHIN 5 METRES
OF ENCLOSURE BASE

B	30.7.09	NOTES 2 & 5 AMENDED	
A	4.9.08	NEW DRAWING	
Iss	Date	Revision note	
Date	Checked by	Date	
Filename - 0230.70018B		Scale - NTS	Designed by - PSB
Title DISABLED ACCESS LIFT LARGE PLATFORM (2mtr MAX TRAVEL)			
Dwg No		0230.70018	Issue B